



## SECTION A - A

SECTION B - B

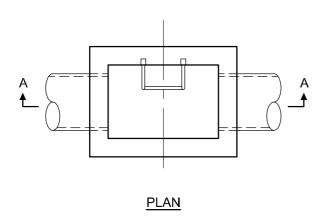



## NOTES:

- PITS DEEPER THAN 1000mm TO BE FITTED WITH STEP IRONS.
- 2. STEP IRONS TO BE LOCATED:
  - DIRECTLY BELOW THE OPENING IN THE COVER.
  - DESIRABLY ON A WALL WITHOUT PIPE OPENINGS.
  - DESIRABLY ON THE WIDEST SIDE OF PIT.
  - STEP IRONS CHANGING PIT FACE ARE TO BE PROVIDED WITH 1.2m OVERLAP.
- STEP IRONS TO BE HOT DIP GALVANIZED TO AS4680 AND TO BE STRUCTURAL GRADE 250 IN ACCORDANCE WITH AS3679. ALL EDGES ARE TO BE ROUNDED.
- GATIC PS2-PF POLYPROPYLENE STEPS (OR APPROVED EQUIVALENT) MAY BE USED AND INSTALLED ACCORDING TO THE MANUFACTURERS SPECIFICATIONS.

Shared\Standard Dwg Review 2007\SD5-7.dwg (22 May, 2009)	NOTES:  1. PITS DEEPER THAN 1000mm TO BE FITTED WITH STEP IRONS.  2. STEP IRONS TO BE LOCATED:						
Roads Shared	Rev Amendments  B Minor drafting modifications		Approved Date 24-5-07	STEP IRON DETAILS		Cad File: SD5-7.DWG Drawn Date: 02/02/09 Revision: B	
name: [\	GENERAL NOTES	S: -DRAWINGS ARE NOT TO S	CALE.	WNDHAM CITY COUNCIL	Engineering Services Approval No.: ES001	Date: 21/05/09	Drawing No. SD5-7
Drawing	GENERAL NOTES:  -DRAWINGS ARE NOT TO SCALE.  -ALL MEASUREMENTS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.  -FOR UP TO DATE DRAWINGS PLEASE CHECK WYNDHAM CITY COUNCIL WEB SITE.  -ALL STANDARD DRAWINGS TO BE USED IN CONJUNCTION WITH SD1-1 (STANDARD CONDITIONS OF USE).						