


SECTIONAL VIEW

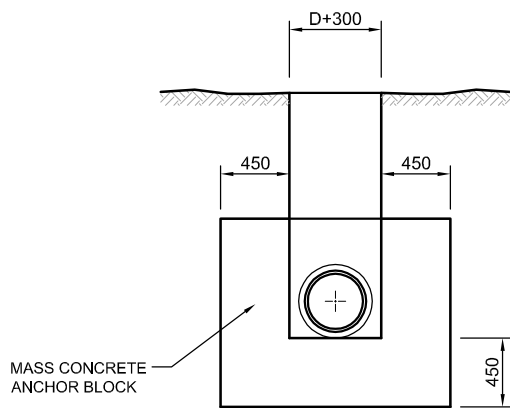

SECTION A-A

NOTES:

1. ANCHOR BLOCKS TO BE USED WHERE THE PIPE SLOPE IS STEEPER THAN 1 IN 3 AND PIPE LENGTH IS GREATER THAN 15m.
2. ANCHOR BLOCKS TO BE LOCATED APPROXIMATELY 2.4m FROM THE OUTLET END, AND;
 - (I) AT 6m SPACINGS FOR DRAINAGE LENGTH 15m - 30m.
 - (II) 10m SPACINGS FOR DRAINAGE LENGTHS 30m - 40m.
 - (III) 15m SPACINGS FOR DRAINAGE LENGTHS GREATER THAN 40m.
3. CONCRETE STRENGTH OF 25MPa AT 28 DAYS.

Drawing name: I:\Roads Shared\Standard Dwg Review 2007\SD6-11.dwg (22 May, 2009)

Rev	Amendments	Approved	Date
B	Minor Drafting Modifications		16-05-07



**ANCHOR BLOCK DETAILS
FOR PIPES UP TO 600 DIAMETER**

Engineering Services Approval No.: ES001

Date: 21/05/09

Cad File : SD6-11.DWG
Drawn Date : 02/02/09
Revision : B
Drawing No. SD6-11

GENERAL NOTES:
 -DRAWINGS ARE NOT TO SCALE.
 -ALL MEASUREMENTS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
 -FOR UP TO DATE DRAWINGS PLEASE CHECK WYNDHAM CITY COUNCIL WEB SITE.
 -ALL STANDARD DRAWINGS TO BE USED IN CONJUNCTION WITH SD1-1 (STANDARD DRAWINGS CONDITIONS OF USE).